

FLF120 Manual, Non-Refrigerated Drinking Fountain

FLF120 is a bracket mounted drinking fountain.


FLF120 delivers ambient drinking water. This drinking fountain is manually activated via the Dial-A-Drink adjustable bubbler.

Complies with ANSI A117.1 and ADA. Shall comply with all relevant CE directives (LVD , EMC, RoHS). Shall comply with ANSI/NSF 61.

Suitable for public building, gymnasiums, sports complexes, hospitals, schools, and offices.



	echanical (Dial-A-Drink Adjustable Bubbler with Flexible Bubbler Guard)
EU ED ATION	
FILTRATION	Green Filter (optional), Built-in 100 micron strainer
AUTO-OFF WATER FLOW	No
DRAINAGE TYPE	Built in drain, Removable drip tray
EXTERIOR	Brushed Stainless Steel
CHASSIS	Heavy Duty Galvanised Steel
DIMENSIONS	233.4(H) x 330.2(W) x 332.6(D) mm
NET WEIGHT	3 kg
POWER SUPPLY	-
COOLING PERFORMANCE	Non-Refrigerated
FULL LOAD AMPS	-
RATED WATTS	-
ENERGY SYSTEM	Refrigeration is on only when in use or if water temp increases during long period of standby.
COUNTRY OF ORIGIN	Mexico
CERTIFICATIONS	ANSI/NSF 61, CABO/ANSI A117.1, ADA, CE (LVD, EMC, RoHS)
WARRANTY	1 Year

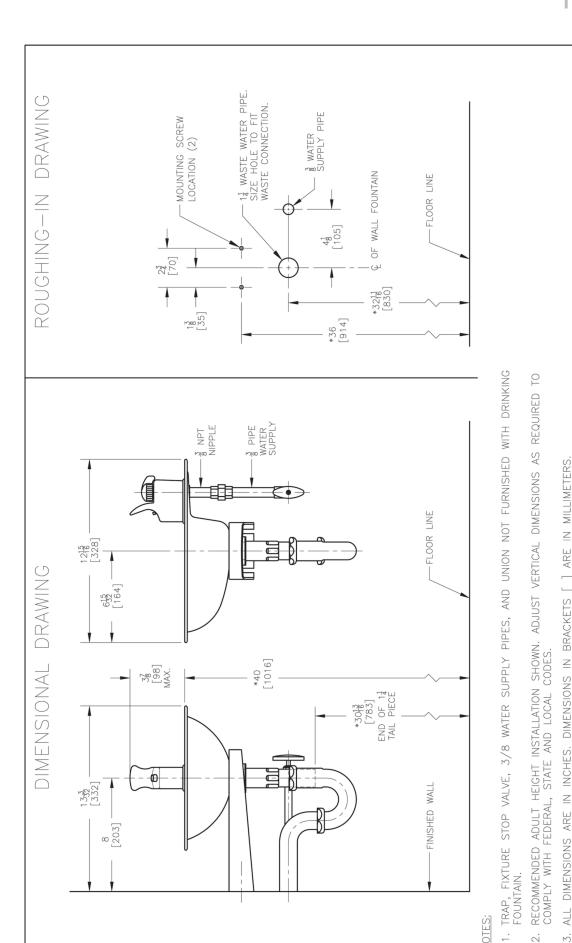



DIMENSIONAL DRAWING ROUGHING-IN

HIRD ANGLE PROJECTION

THE FOLLOWING STATES REQUIRE A LICENSED PLUMBER TO INSTALL FOUNTAIN; AR, GA, MA, MI, OK, RI, SC, SD, TX, VT AND WI. CA, KS, MN, NM, AND OR ALLOW FOR A STATE REGISTERED INSTALLER OR CONTRACTOR AS WELL. STATE AND LOCAL PLUMBING CODES MAY PROHIBIT THE USE OF SADDLE TAPPING VALVES FOR WATER LINE CONNECTION IN SOME APPLICATIONS. ALL CONNECTIONS MUST CONFORM TO SC, SD, TX, VT AND WI. CA, KS, MN, NM, AND OR ALLOW FUR CONTRACTOR AS WELL. STATE AND LOCAL PLUMBING CODES M VALVES FOR WATER LINE CONNECTION IN SOME APPLICATIONS. APPLICABLE PLUMBING CODES.







FINISHED WALL

×.

NOTES:

COMPLY WITH FEDERAL,

М.